


WHEN CONNECTING A 4050 EVAPORATOR TO A 3110 COMPRESSOR/CONDENSER UNIT ATTACH EACH RED WIRE TO YOUR CHOSEN POWER SUPPLY AND EACH BLACK WIRE TO A NEARBY GROUND. CONNECT THE BLUE WIRE FROM THE 4050 TO THE GREEN WIRE FROM THE 3110.

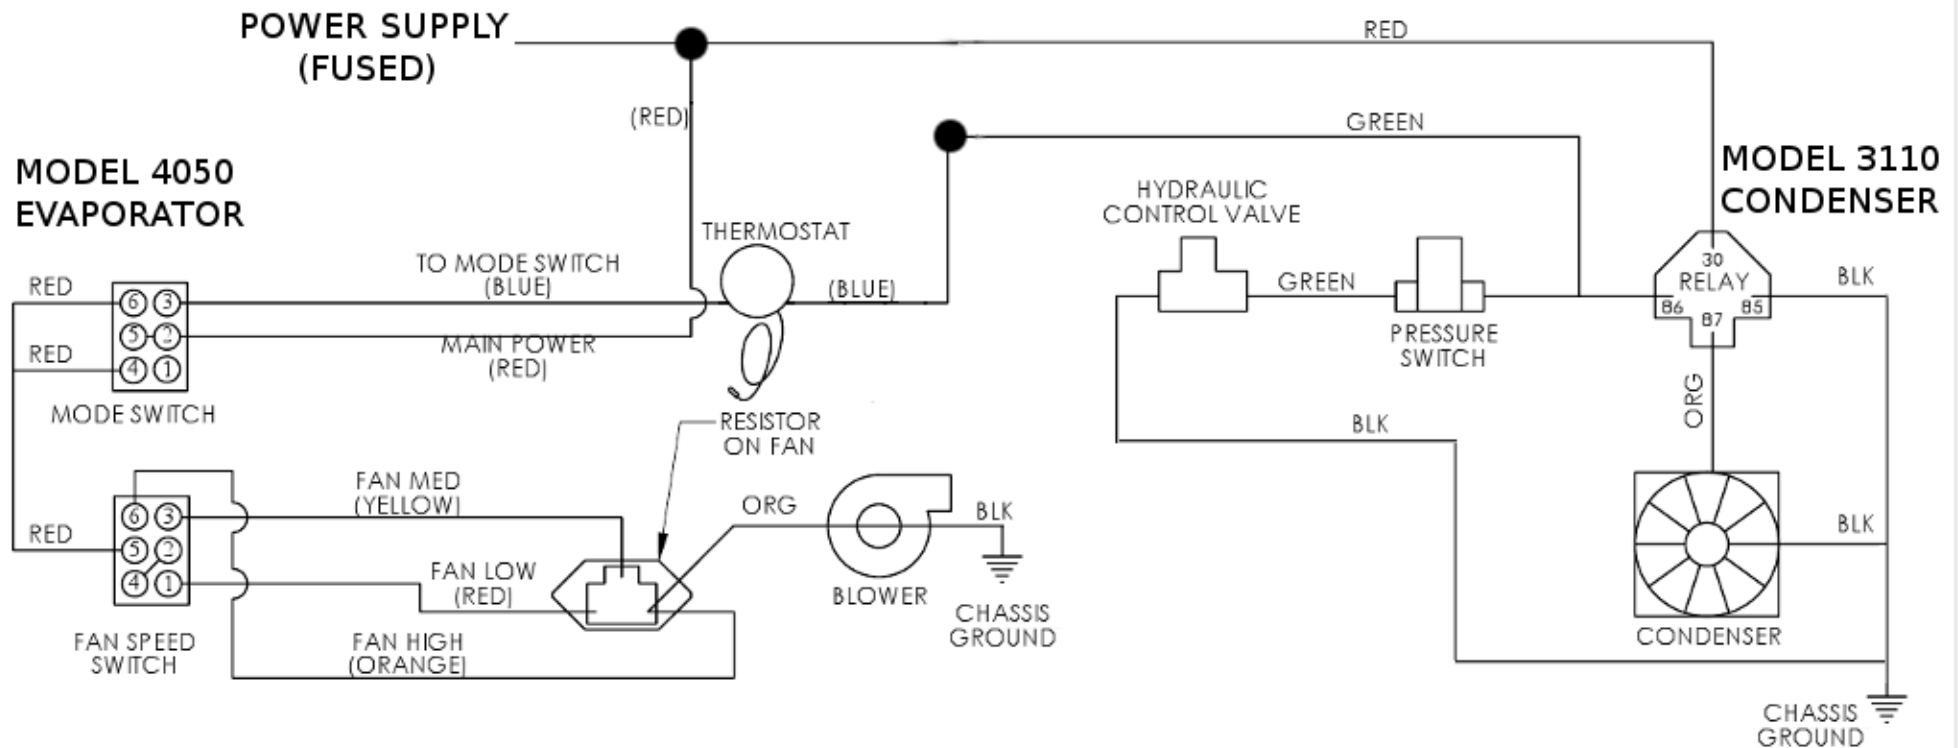

UNLESS OTHERWISE SPECIFIED:

DIMENSIONS ARE IN INCHES
 TOLERANCES:
 FRACTIONAL $\pm 1/16$
 ANGULAR: BEND ± 1 DEG
 TWO PLACE DECIMAL ± 0.020
 THREE PLACE DECIMAL ± 0.010

INTERPRET GEOMETRIC
 TOLERANCING PER:

MATERIAL

X

FINISH

X

DO NOT SCALE DRAWING

NAME DATE

DRAWN

CHECKED

ENG APPR.

MFG APPR.

Q.A.

COMMENTS:

AS USED ON

VISIONAIRE, INC.

TITLE:

**CONNECT 4050/3110
 WIRING**

SIZE DWG. NO.

A

REV

0

SCALE: 1:6 WEIGHT:

SHEET 1 OF 1

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF VISIONAIRE, INC. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF VISIONAIRE, INC. IS PROHIBITED.